



ELEVATION

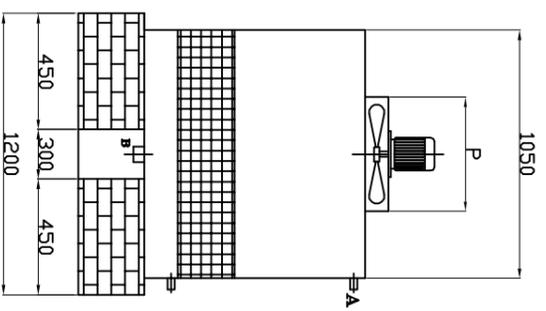

SIDE VIEW

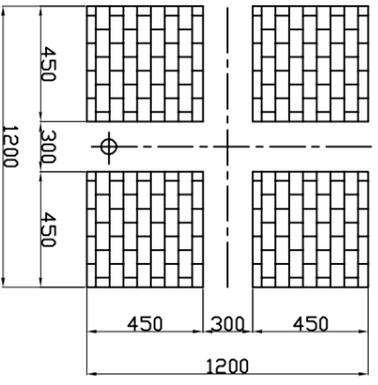

PLAN

DISCRIPTION	MARK	SIZES
INLET PIPE CONNECTION	A	2.5" X 1 No.
OUT LET PIPE CONNECTION	B	2.5" X 1 No.
DRAIN & OVERFLOW CONNECTION	C	1.5" EACH
MAKE UP AND QUICKFILL CONNECTION	D	1" EACH
LENGTH OF COOLING TOWER		1050
WIDTH OF COOLING TOWER		1050
FAN DIA AND NOS.	P	Ø700 X 1 No.

- NOTES:-**
- 1 ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED
  - 2 COOLING TOWER WILL BE ASSEMBLED ON BRICK PILLER
  - 3 MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREAD CONNECTIONS AS PER IS - 544-1956
  - 4 INLET AND OUTLET CONNECTION TO BE PROVIDED WITH FLANGE CONNECTIONS AS PER TABLE "E" OF IS.
  5. BRICK PILLER 450 X 450 X 600 HEIGHT

DELTA COOLING TOWERS P. LTD.	
DESIGN	
CHECKED	
APPROVED	
SCALE	SCALE 1/10
JOB NO.	
REV.	REV-0

G.A OF DRG. OF COOLING TOWER MODEL NO.6020/6025 SERIES- DPC 60