



ELEVATION

SIDE VIEW

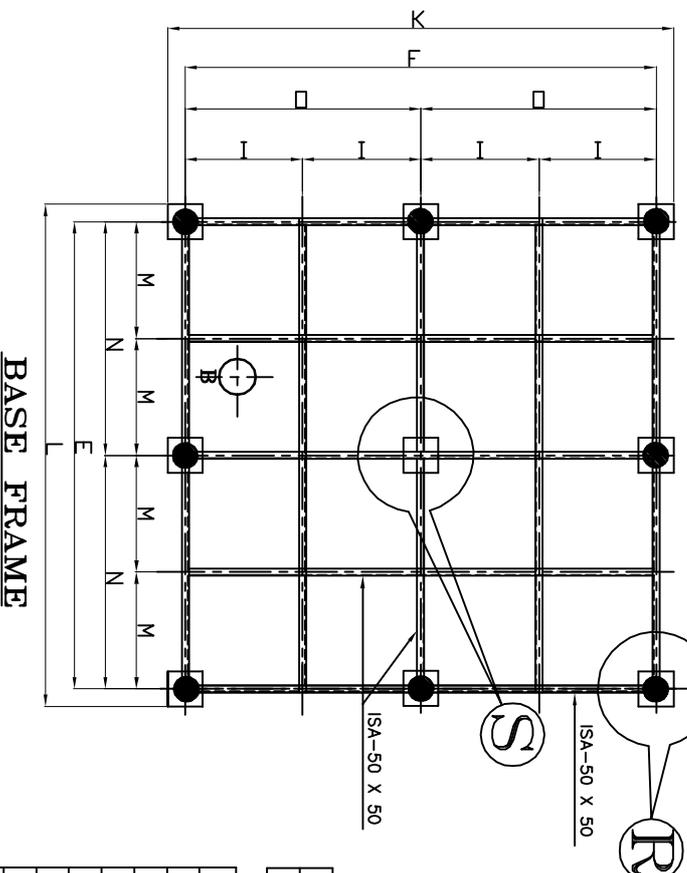

BASE FRAME

ELEVATION OF PILER WITH BOLT IN THE CENTER OF MKD-'R'
(QTY - 08 Nos.)

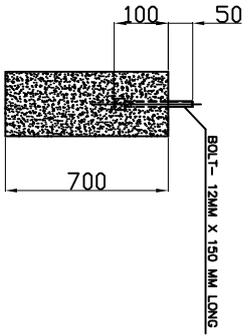

F	E	K	L	M	N	O	I	P
1892	2200	2142	2450	550	1100	946	473	1200

DISCRPTION	MARK	SIZES
INLET PIPE CONNECTION	A	100 X 2 Nos.
OUT LET PIPE CONNECTION	B	125 X 1 Nos.
DRAIN & OVERFLOW CONNECTION	C	50" EACH
MAKE UP AND QUICKFILL CONNECTION	D	25 EACH
LENGTH OF COOLING TOWER	E	2200
WIDTH OF COOLING TOWER	F	1892
FAN DIA AND NOS.	P	Ø1200 X 1 No.

NOTES:-

- 1 ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
- 2 COOLING TOWER WILL BE ASSEMBLED ON ISA FRAME FIXED ON RCC PILLAR THE FRAME IS UNDER PURCHASERS SCOPE.
- 3 MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREAD CONNECTIONS AS PER IS - 544-1955.
- 4 INLET AND OUTLET CONNECTION TO BE PROVIDED WITHOUT FLANGE.
- 5 RCC BASIN AND RCC PILLERS 250X250X700 HIGHT AND Ø12 X 150 LONG BOLTS ARE UNDER PERCHASER SCOPE.
- 6 10mm HOLE AT THE DISTANCE OF 5" ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.
- 7 LOCATION OF OUTLET CONNECTION ACCORDING TO SITE REQUIREMENT.
- 8 Ø12X150 LONG BOLTS SHALL BE GROUTED IN THE CENTRE OF OUTER COLUMNS AS SHOWN IN THE DRAWING.
- 9 ALL ISA (ANGLES ON PERIPHERAL WILL FACE OUTSIDE LEFT .

DELTA COOLING TOWERS P. LTD.

SITE: -

DES. *Large*
 DRN. *Large*
 CHKD. *Large*
 APPD. *Large*
 SCALE NOT TO SCALE
 JOB NO. *Large*
 G.A OF DRG. OF COOLING TOWER MODEL NO.6080
 SERIES - DFC 60

REV-0