


**ELEVATION**


**SIDE VIEW**

**ELEVATION OF PILER  
(QTY - 01 No.)  
WITHOUT BOLT OF MKD-'S'**

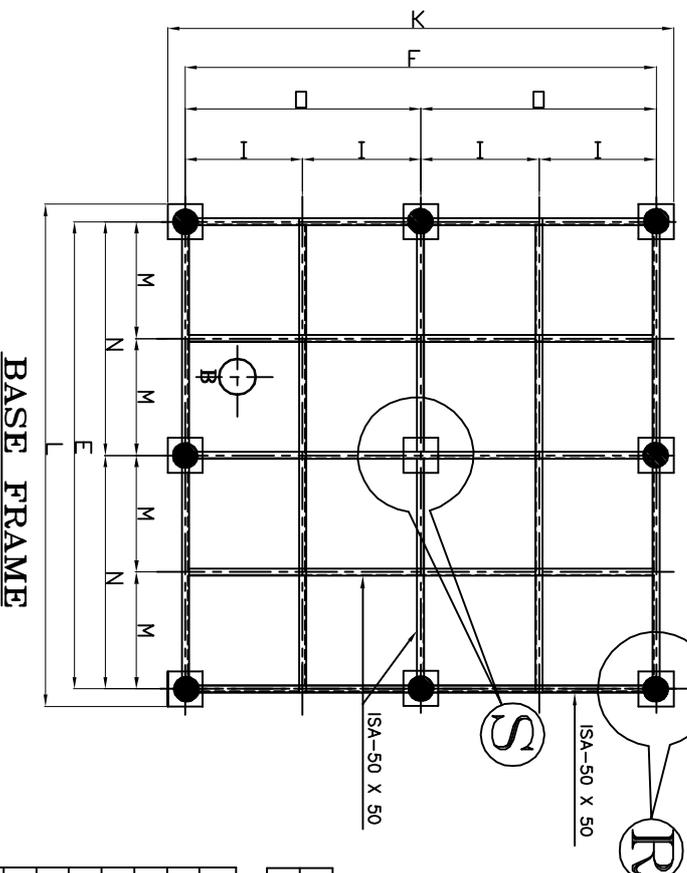

**BASE FRAME**

**ELEVATION OF PILER WITH  
BOLT IN THE CENTER OF MKD-'R'**  
(QTY - 08 Nos.)

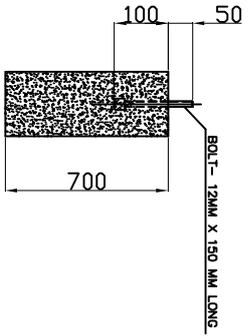

F	E	K	L	M	N	O	I	P
2200	2200	2450	2450	550	1100	1100	550	1200

DISCRPTION	MARK	SIZES
INLET PIPE CONNECTION	A	100 X 2 Nos.
OUT LET PIPE CONNECTION	B	125 X 1 Nos.
DRAIN & OVERFLOW CONNECTION	C	50" EACH
MAKE UP AND QUICKFILL CONNECTION	D	40 EACH
LENGTH OF COOLING TOWER	E	2200
WIDTH OF COOLING TOWER	F	2200
FAN DIA AND NOS.	P	Ø1200 X 1 No.

- NOTES:-**
- 1 ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
  - 2 COOLING TOWER WILL BE ASSEMBLED ON ISA FRAME FIXED ON RCC PILLAR THE FRAME IS UNDER PURCHASERS SCOPE.
  - 3 MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREAD CONNECTIONS AS PER IS - 544-1955.
  - 4 INLET AND OUTLET CONNECTION TO BE PROVIDED WITHOUT FLANGE.
  - 5 RCC BASIN AND RCC PILLERS 250X250X700 HIGHT AND Ø12 X 150 LONG BOLTS ARE UNDER PERCHASER SCOPE.
  - 6 10mm HOLE AT THE DISTANCE OF 5" ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.
  - 7 LOCATION OF OUTLET CONNECTION ACCORDING TO SITE REQUIREMENT.
  - 8 Ø12X150 LONG BOLTS SHALL BE GROUNTED IN THE CENTRE OF OUTER COLUMNS AS SHOWN IN THE DRAWING.
  - 9 ALL ISA (ANGLES ON PERIPHERAL WILL FACE OUTSIDE IeT' .

**DELTA COOLING TOWERS P. LTD.**

SITE: -

DES.	DRN	CHKD	APPD	SCALE NOT TO SCALE	JOB NO.	REV-0
	Large	h-5-12				
				<b>G.A OF DRG. OF COOLING TOWER MODEL NO.6090 SERIES - DFC 60</b>		