


**ELEVATION**

**SIDE VIEW**

ISA-50 X 50

ISA-50 X 50

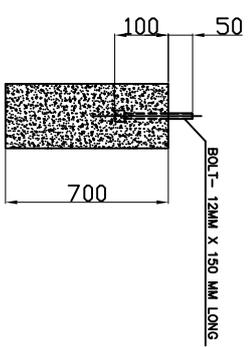


**ELEVATION OF PILLER WITH BOLT IN THE CENTER OF MKD-"R"**  
(QTY - 08 Nos.)

F	E	K	L	M	N	O	I	P
2196	2508	2394	2758	627	1254	1098	549	1200

DISCRPTION	MARK	SIZES
INLET PIPE CONNECTION	A	100 X 2 Nos.
OUT LET PIPE CONNECTION	B	125 X 1 Nos.
DRAIN & OVERFLOW CONNECTION	C	50" EACH
MAKE UP AND QUICKFILL CONNECTION	D	40 EACH
LENGTH OF COOLING TOWER	E	2508
WIDTH OF COOLING TOWER	F	2196
FAN DIA AND NOS.	P	Ø1200 X 1 No.

**BASE FRAME**

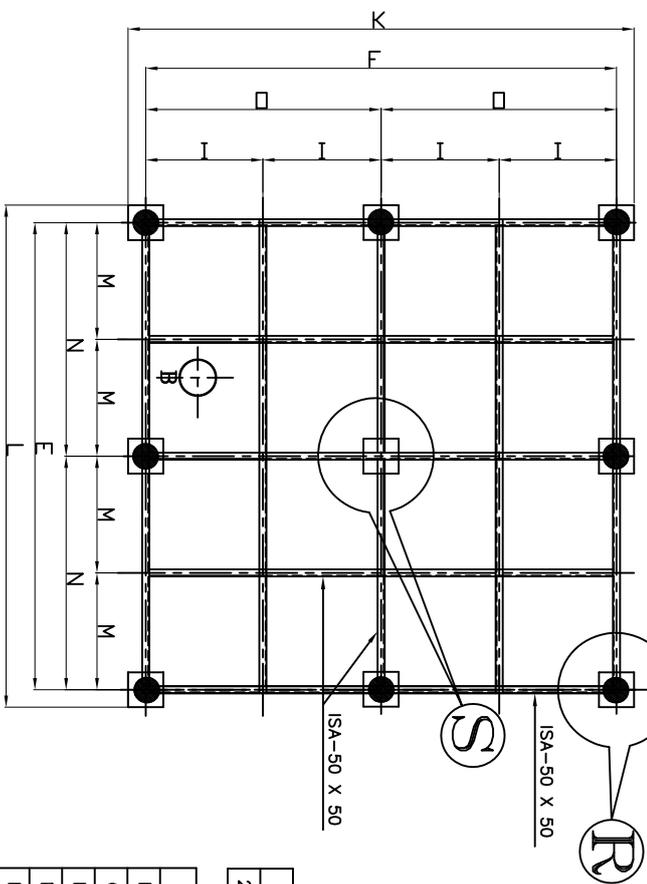

**NOTES:-**

- ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
- COOLING TOWER WILL BE ASSEMBLED ON ISA FRAME FIXED ON RCC PILLAR THE FRAME IS UNDER PURCHASERS SCOPE.
- MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREAD CONNECTIONS AS PER IS - 544-1955.
- INLET AND OUTLET CONNECTION TO BE PROVIDED WITHOUT FLANGE.
- RCC BASIN AND RCC PILLERS 250X250X700 HIGHT AND Ø12 X 150 LONG BOLTS ARE UNDER PERCHASER SCOPE.
- 10mm HOLE AT THE DISTANCE OF 5" ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.
- LOCATION OF OUTLET CONNECTION ACCORDING TO SITE REQUIREMENT.
- Ø12X150 LONG BOLTS SHALL BE GROUTED IN THE CENTRE OF OUTER COLUMNS AS SHOWN IN THE DRAWING.
- ALL ISA (ANGLES ON PERIPHERAL WILL FACE OUTSIDE IeT .

**DELTA COOLING TOWERS P. LTD.**

SITE:-

DES. *Langul*  
 DRN. *Langul*  
 CHKD. *Pr-6-12*  
 APPD. *Pr-6-12*  
 SCALE NOT TO SCALE  
**G.A OF DRG. OF COOLING TOWER MODEL NO.6110 SERIES- DFC 60**

JOB NO.

REV-0