


ELEVATION


OUTLET CONNECTIONS WITHOUT FLANGES (TYPICAL) AS PER SITE REQUIREMENT.

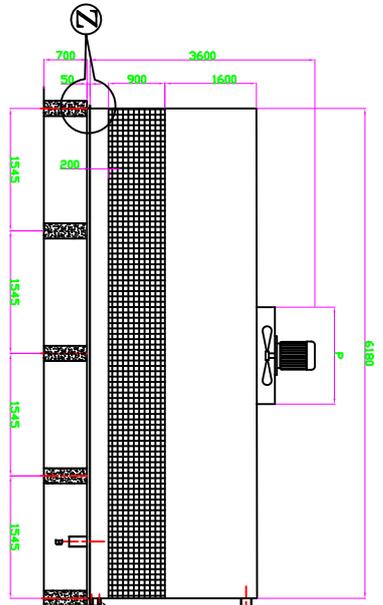

SIDE VIEW


MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREADED CONNECTIONS AS PER IS-544-1955.

ELEVATION OF PILLER WITHOUT BOLT OF MKD-"S" (QTY- 15 Nos.)




DETAIL-X

10 mm. HOLES AT THE DISTANCE OF 125mm. ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.



DETAIL-Z

ALL PERIPHERAL ISA (ANGLES) SHALL BE FACED OUTSIDE AND THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.

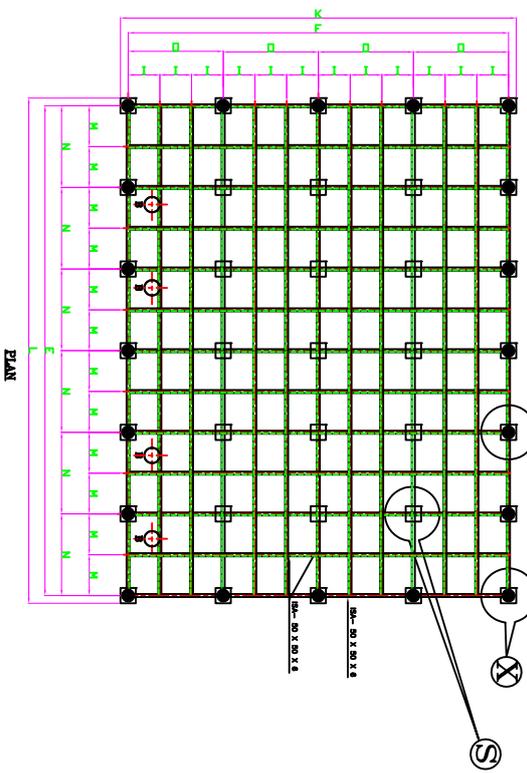

PLAN

K	F	O	I	L	E	N	M	P
6430	6180	1545	515	8266	8016	1336	668	2700

DISCRIPTION	MARK	SIZES
INLET PIPE CONNECTION	A	200 x 4 NOS
OUT LET PIPE CONNECTION	B	200 x 4 NOS
DRAIN & OVERFLOW CONNECTION	C	50 EACH
MAKE UP AND QUICKFILL CONNECTION	D	40 EACH
LENGTH OF COOLING TOWER	E	8016
WIDTH OF COOLING TOWER	F	6180
FAN DIA AND NOS.	P	Ø2700 X 2 Nos.

ELEVATION OF PILLER WITH BOLT IN THE CENTER OF MKD-"R" (QTY-20 Nos.)



NOTES:-

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
2. COOLING TOWER WILL BE ASSEMBLED ON ISA FRAME FIXED ON RCC FILLER THE FRAME IS UNDER PURCHASERS SCOPE.
3. MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREADED CONNECTIONS AS PER IS-544-1955.
4. INLET & OUTLET CONNECTION TO BE PROVIDED WITHOUT FLANGE.
5. RCC BASIN AND RCC PILLERS 250x250x700 HEIGHT AND Ø12x 150 LONG BOLTS ARE UNDER PURCHASER SCOPE.
6. Ø10 mm HOLE AT THE DISTANCE OF 5" ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.
7. LOCATION OF OUTLET CONNECTION ACCORDING TO SITE REQUIREMENT.
8. Ø12x150 LONG BOLTS SHALL BE GROUTED IN THE CENTRE OF OUTER COLUMNS AS SHOWN IN THE DRAWING.
9. ALL ISA (ANGLES) ON PERIPHERAL WILL FACE OUTSIDE ie IT

DELTA COOLING TOWERS P. LTD.

DESIGNER	DRN	APPRD	SCALE	JOB NO.	REV-0
DATE	APPD	SCALE	JOB NO.	REV-0	
G.A OF DRG. OF COOLING TOWER MODEL NO. 61KO SERIES- DFC 60					