




ELEVATION

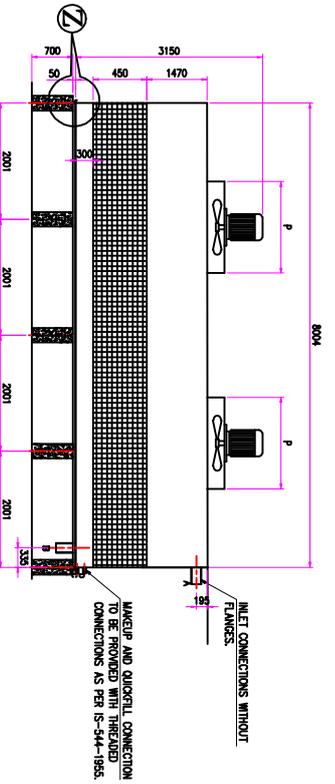

SIDE VIEW

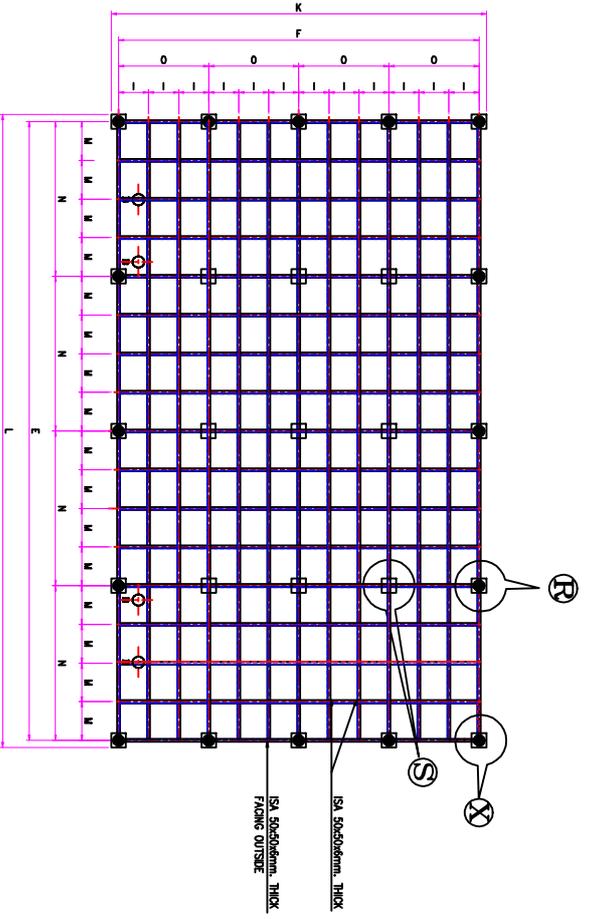


PLAN



10 mm HOLES AT THE DISTANCE OF 125mm. ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.

ELEVATION OF PILLER WITHOUT BOLT OF MKD-"S" (QTY - 9 Nos.)



ALL PERIPHERAL ISA (ANGLES) SHALL BE FACED OUTSIDE AND THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.

ELEVATION OF PILLER WITH BOLT IN THE CENTER OF MKD-"R" (QTY - 16 Nos.)

K	F	O	I	L	E	N	M	P
8254	8004	2001	667	8874	8624	2196	539	2400

DISCRIPTION	MARK	SIZES
INLET PIPE CONNECTION	A	200 x 4 NOS
OUT LET PIPE CONNECTION	B	200 x 4 NOS
DRAIN & OVERFLOW CONNECTION	C	50 EACH
MAKE UP AND QUICKFILL CONNECTION	D	40 EACH
LENGTH OF COOLING TOWER	E	8624
WIDTH OF COOLING TOWER	F	8004
FAN DIA AND NOS.	P	42400 x 4 Nos.

- NOTES:-**
- ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
  - COOLING TOWER WILL BE ASSEMBLED ON ISA FRAME FIXED ON RCC PILLER THE FRAME IS UNDER PURCHASER'S SCOPE.
  - MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREAD CONNECTIONS AS PER IS-544-1955.
  - INLET & OUTLET CONNECTION TO BE PROVIDED WITHOUT FLANGE.
  - RCC BASIN AND RCC PILLERS 280x280x700 HEIGHT AND #12x 150 LONG BOLTS ARE UNDER PURCHASER SCOPE.
  - #10 mm HOLE AT THE DISTANCE OF 5" ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.
  - LOCATION OF OUTLET CONNECTION ACCORDING TO SITE REQUIREMENT.
  - #12x150 LONG BOLTS SHALL BE GROUNDED IN THE CENTRE OF OUTER COLUMNS AS SHOWN IN THE DRAWING.
  - 9 ALL ISA (ANGLES) ON PERIPHERAL WILL FACE OUTSIDE i.e. II**

DELTA COOLING TOWERS P. LTD.

G.A. OF DRG. OF COOLING TOWER MODEL NO. 61K3 SERIES - DFC 60

DRN. \_\_\_\_\_

CHKD. \_\_\_\_\_

APPD. \_\_\_\_\_

SCALE NOT TO SCALE

JOB NO. \_\_\_\_\_

REV-0