




**ELEVATION**

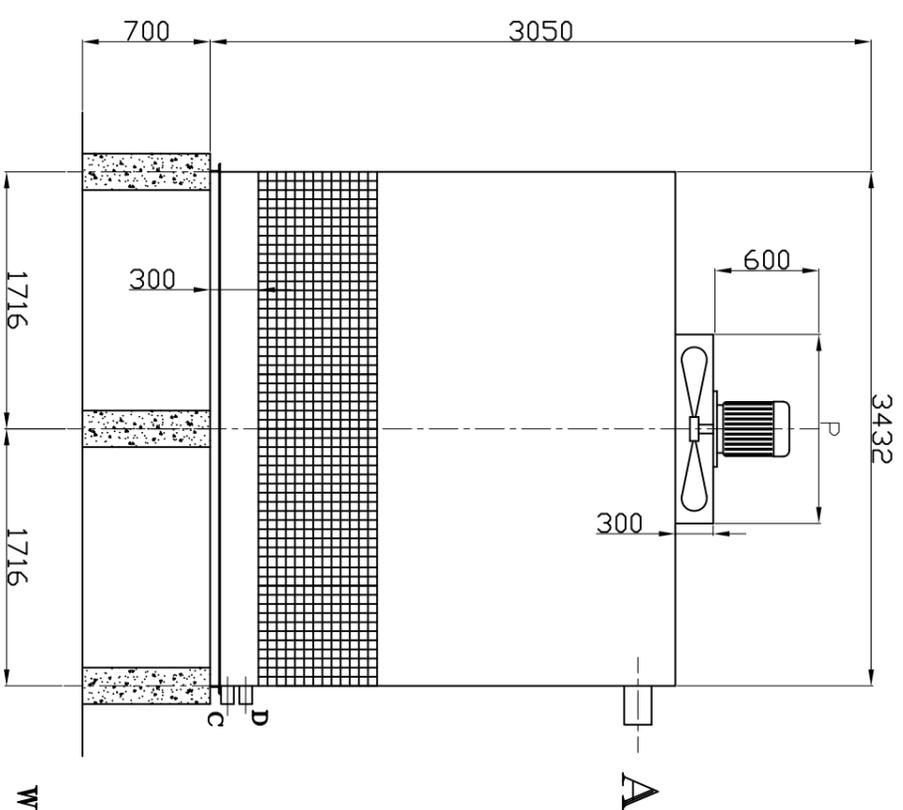


**SIDE VIEW**

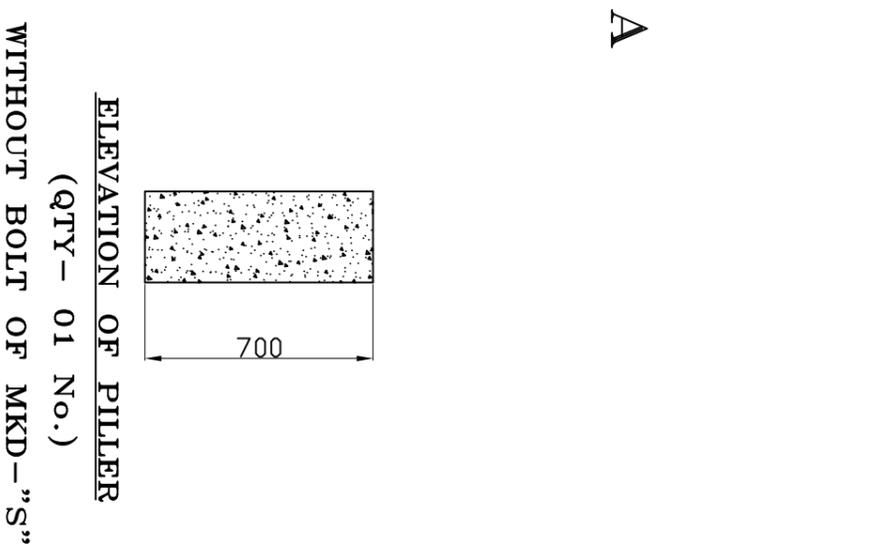

**ELEVATION OF PILLER  
(QTY - 01 No.)  
WITHOUT BOLT OF MKD-"S"**

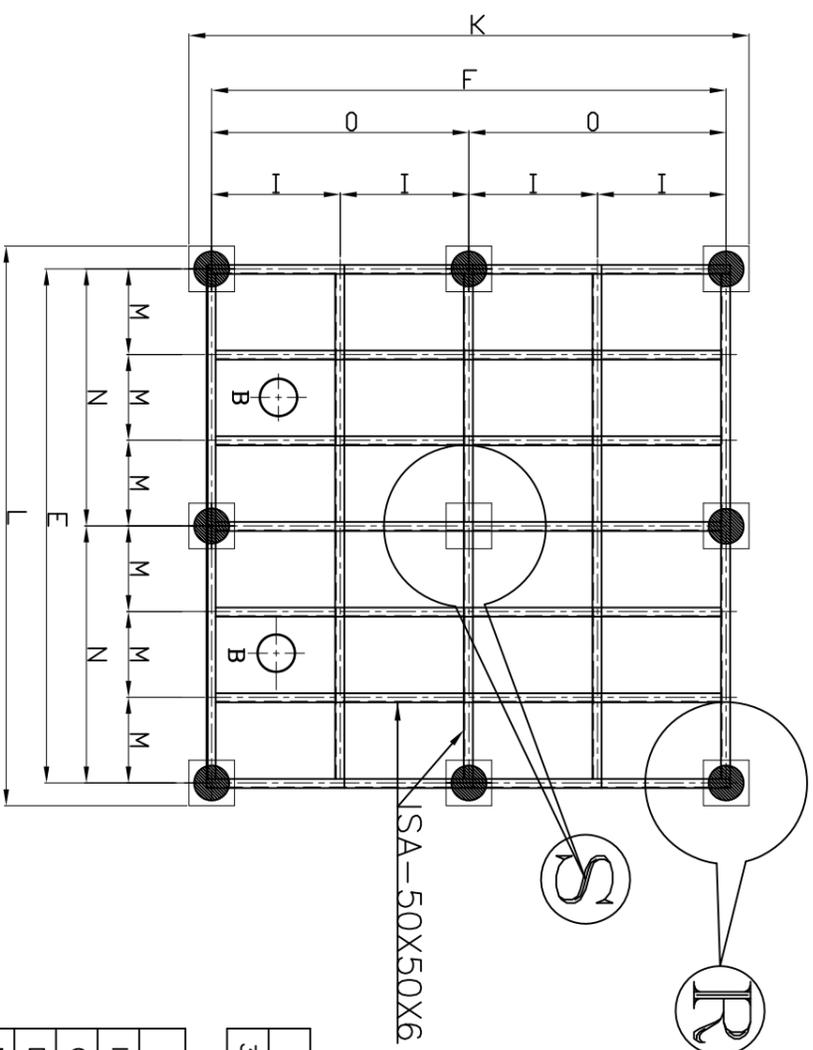

**BASE FRAME**

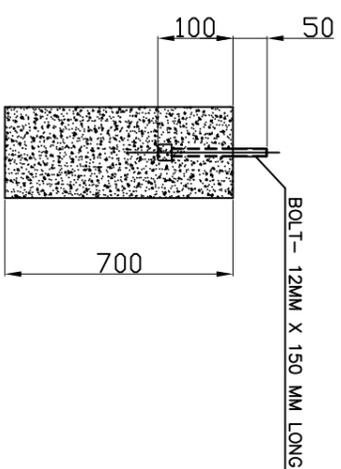

**ELEVATION OF PILLER WITH  
BOLT IN THE CENTER OF MKD-"R"  
(QTY - 08 Nos.)**

F	E	K	L	M	N	O	I	P
3432	3432	3682	3682	572	1716	1716	572	1800

DISCRPTION	MARK	SIZES
INLET PIPE CONNECTION	A	125 X 2 NOS
OUT LET PIPE CONNECTION	B	125 X 2 NOS.
DRAIN & OVERFLOW CONNECTION	C	50 EACH
MAKE UP AND QUICKFILL CONNECTION	D	40 EACH
LENGTH OF COOLING TOWER	E	3432
WIDTH OF COOLING TOWER	F	3432
FAN DIA AND NOS.	P	Ø1800 X 1 No.

- NOTES:-**
- 1 ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
  - 2 COOLING TOWER WILL BE ASSEMBLED ON ISA FRAME FIXED ON RCC PILLAR THE FRAME IS UNDER PURCHASERS SCOPE.
  - 3 MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREAD CONNECTIONS AS PER IS -544-1955.
  - 4 INLET AND OUTLET CONNECTION TO BE PROVIDED WITHOUT FLANGE.
  - 5 RCC BASIN AND RCC PILLERS 250X250X700 HIGHT AND Ø12 X 150 LONG BOLTS ARE UNDER PERCHASER SCOPE.
  - 6 10mm HOLE AT THE DISTANCE OF 5" ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.
  - 7 LOCATION OF OUTLET CONNECTION ACCORDING TO SITE REQUIREMENT.
  - 8 Ø12X150 LONG BOLTS SHALL BE GROUTED IN THE CENTRE OF OUTER COLUMNS AS SHOWN IN THE DRAWING.
  - 9 ALL ISA (ANGLES ON PERIPHERAL WILL FACE OUTSIDE i.e.T .

**DELTA COOLING TOWERS P. LTD.**

**G.A DRG. OF COOLING  
TOWER MODEL NO. 6225  
SERIES- DFC 60**

JOB NO. \_\_\_\_\_ REV-0