



ELEVATION



SIDE VIEW

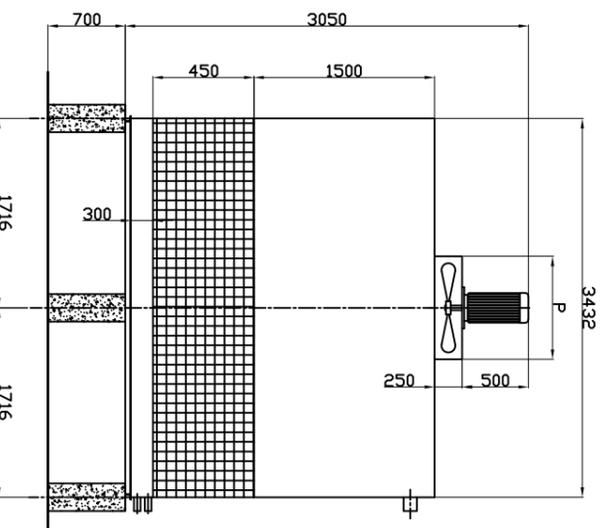


ELEVATION OF PILLER
(QTY - 01 No.)
WITHOUT BOLT OF MKD-"S"



ELEVATION OF PILLER WITH
BOLT IN THE CENTER OF MKD-"R"
(QTY - 08 Nos.)

F	E	K	L	M	N	O	I	P
3432	3738	3682	3988	623	1869	1716	572	1200

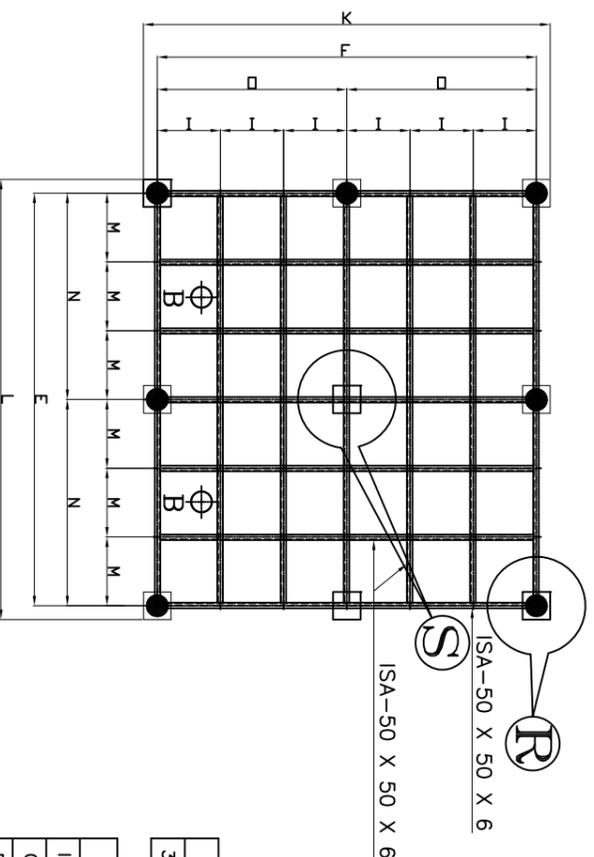

BASE FRAME

DISCRPTION	MARK	SIZES
INLET PIPE CONNECTION	A	150 X 2 NOS
OUT LET PIPE CONNECTION	B	150 X 2 NOS.
DRAIN & OVERFLOW CONNECTION	C	50 EACH
MAKE UP AND QUICKFILL CONNECTION	D	40 EACH
LENGTH OF COOLING TOWER	E	3738
WIDTH OF COOLING TOWER	F	3432
FAN DIA AND NOS.	P	φ1200 X 2 Nos.

NOTES:-

- ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
- COOLING TOWER WILL BE ASSEMBLED ON ISA FRAME FIXED ON RCC PILLAR THE FRAME IS UNDER PURCHASERS SCOPE.
- MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREAD CONNECTIONS AS PER IS -544-1955.
- INLET AND OUTLET CONNECTION TO BE PROVIDED WITHOUT FLANGE.
- RCC BASIN AND RCC PILLERS 250X250X700 HIGHT AND φ12 X 150 LONG BOLTS ARE UNDER PURCHASER SCOPE.
- 10mm HOLE AT THE DISTANCE OF 5" ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.
- LOCATION OF OUTLET CONNECTION ACCORDING TO SITE REQUIREMENT.
- φ12X150 LONG BOLTS SHALL BE GROUTED IN THE CENTER OF OUTER COLUMNS AS SHOWN IN THE DRAWING.
- ALL ISA ANGLES ON PERIPHERAL WILL FACE OUTSIDE ie Tf.

DELTA COOLING TOWERS P. LTD.

G.A OF DRG. OF COOLING
TOWER MODEL NO.6250
SERIES- DFC 60

DES. DRN. SANJU
CHKD. APD
SCALE NOT TO SCALE

JOB NO. REV-0