

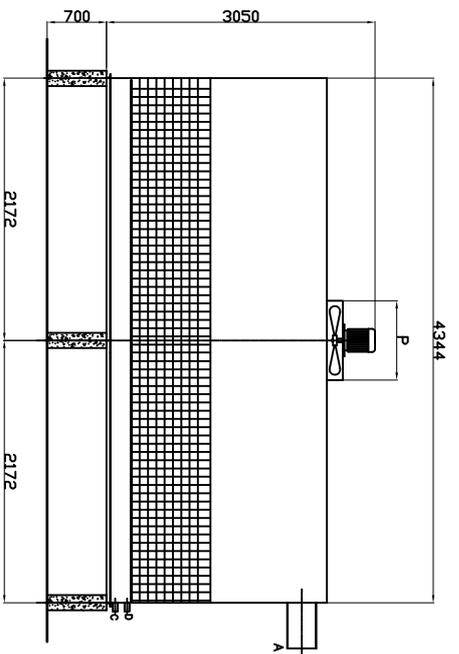


ELEVATION

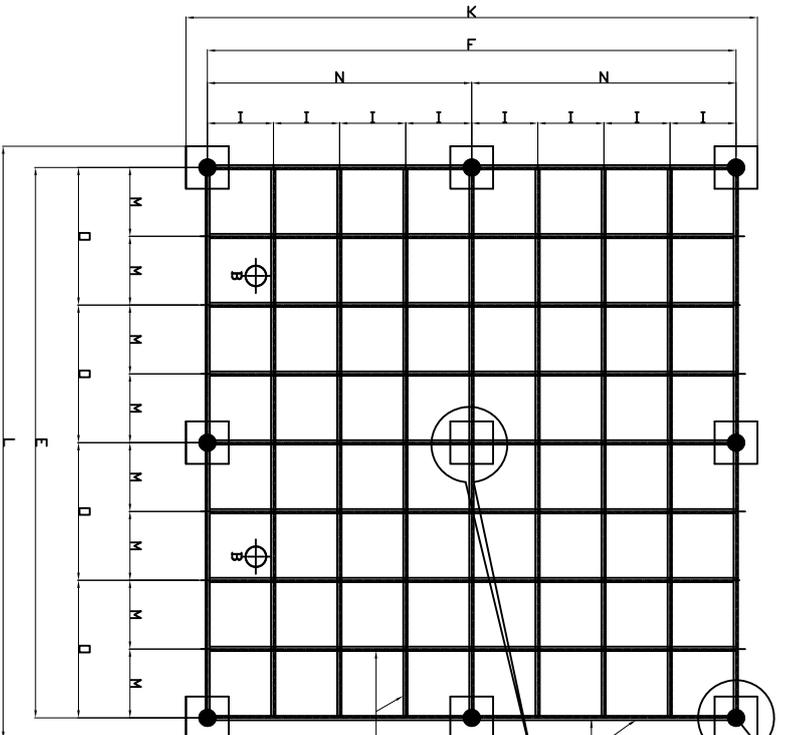

SIDE VIEW

ELEVATION OF PILLAR  
(QTY- 01 No.)  
WITHOUT BOLT OF MKD-"S"



BASE FRAME


16-12MM X 150 MM LONG

ISA-50 X 50 X 6

ISA-50 X 50 X 6

ISA-50 X 50 X 6

ELEVATION OF PILLER WITH  
BOLT IN THE CENTER OF MKD-"R"  
(QTY-8 Nos.)



K	F	N	I	I	E	O	M	P
4594	4344	2172	543	4594	4344	2172	543	1500

DESCRIPTION	MARK	SIZES
INLET PIPE CONNECTION	A	150 X 2 Nos.
OUT LET PIPE CONNECTION	B	150 X 2 Nos.
DRAIN & OVERFLOW CONNECTION	C	50 EACH
MAKE UP AND QUICKFILL CONNECTION	D	40 EACH
LENGTH OF COOLING TOWER	E	4344
WIDTH OF COOLING TOWER	F	4344
FAN DIA AND NOS.	P	Ø1500 X 2 Nos.

NOTES:-

- 1 ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
- 2 COOLING TOWER WILL BE ASSEMBLED ON ISA FRAME FIXED ON RCC PILLAR THE FRAME IS UNDER PURCHASERS SCOPE.
- 3 MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREAD CONNECTIONS AS PER IS -544-1955.
- 4 INLET & OUTLET CONNECTION TO BE PROVIDED WITHOUT FLANGE.
- 5 RCC BASIN AND RCC PILLERS 250X250X700 HIGH AND Ø12 X 150 LONG BOLTS ARE UNDER PURCHASER SCOPE.
6. 10mm HOLE AT THE DISTANCE OF 5" ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.
7. LOCATION OF OUTLET CONNECTION ACCORDING TO SITE REQUIREMENT.
8. Ø12X150 LONG BOLTS SHALL BE GROUDED IN THE CENTRE OF OUTER COLUMNS AS SHOWN IN THE DRAWING.
9. ALL ISA (ANGLES ON PERIPHERAL SIDES WILL FACE OUTSIDE ie IT.

DELTA COOLING TOWERS P. LTD.

SITE:-

DES.	DRN	CHKD	APPD
	1-3-14		

G.A OF DRG. OF COOLING  
TOWER MODEL NO. 6375  
SERIES- DFC 60

JOB NO.

REV-0