

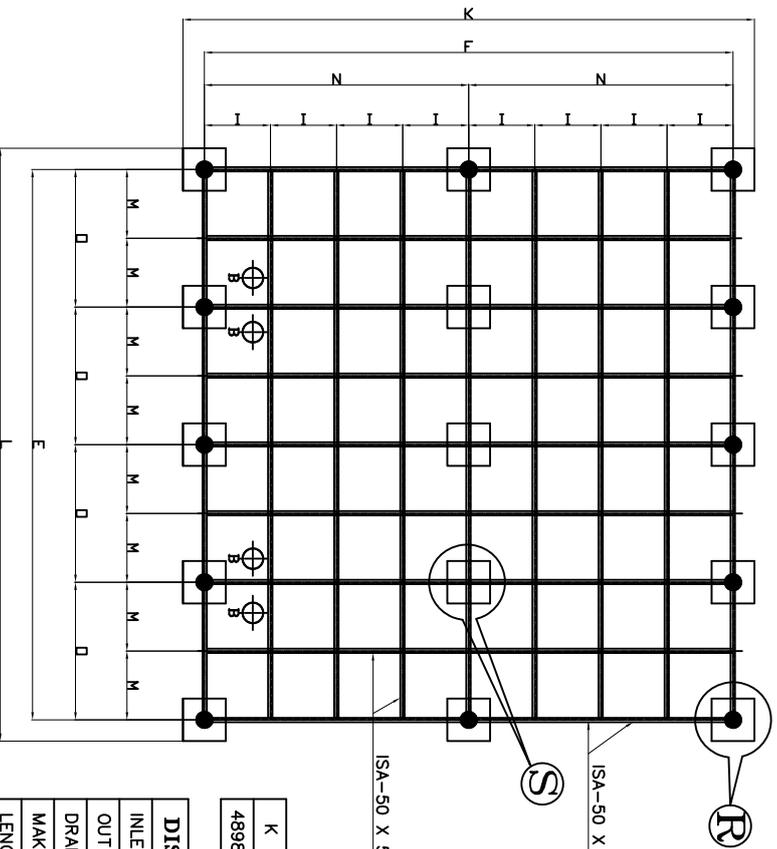


ELEVATION OF PILLAR
(QTY- 03 Nos.)
WITHOUT BOLT OF MKD-"S"



ISA-50 X 50 X 6
ISA-50 X 50 X 6

**ELEVATION OF PILLER WITH
BOLT IN THE CENTER OF MKD-"R"
(QTY-12 Nos.)**



K	F	N	I	I	E	O	M	P
4898	4648	2324	581	5202	4952	1238	619	2100

DESCRIPTION	MARK	SIZES
INLET PIPE CONNECTION	A	150 X 4 Nos.
OUT LET PIPE CONNECTION	B	150 X 4 Nos.
DRAIN & OVERFLOW CONNECTION	C	75 X 1
MAKE UP AND QUICKFILL CONNECTION	D	40 X 1
LENGTH OF COOLING TOWER	E	4952
WIDTH OF COOLING TOWER	F	4648
FAN DIA AND NOS.	P	Ø2100 X 2 Nos.

NOTES:-

- 1 ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
- 2 COOLING TOWER WILL BE ASSEMBLED ON ISA FRAME FIXED ON RCC PILLAR THE FRAME IS UNDER PURCHASERS SCOPE.
- 3 MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREAD CONNECTIONS AS PER IS -544-1955.
- 4 INLET & OUTLET CONNECTION TO BE PROVIDED WITHOUT FLANGE.
- 5 RCC BASIN AND RCC PILLERS 250X250X700 HIGHT AND Ø12 X 150 LONG BOLTS ARE UNDER PURCHASER SCOPE.
6. 10mm HOLE AT THE DISTANCE OF 5" ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.
7. LOCATION OF OUTLET CONNECTION ACCORDING TO SITE REQUIREMENT.
8. Ø12X150 LONG BOLTS SHALL BE GROUTED IN THE CENTRE OF OUTER COLUMNS AS SHOWN IN THE DRAWING.
9. ALL ISA (ANGLES ON PERIPHERAL SIDES WILL FACE OUTSIDE ie IT.

DELTA COOLING TOWERS P. LTD.

SITE:-

DES.	DRN	CHKD	APPD
	15-4-13		

G.A OF DRG. OF COOLING
TOWER MODEL NO. 6450
SERIES- DFC 60

JOB NO.

REV-0

BASE FRAME