



ELEVATION

OUTLET CONNECTIONS WITHOUT FLANGES (TYPICAL) AS PER SITE REQUIREMENT.

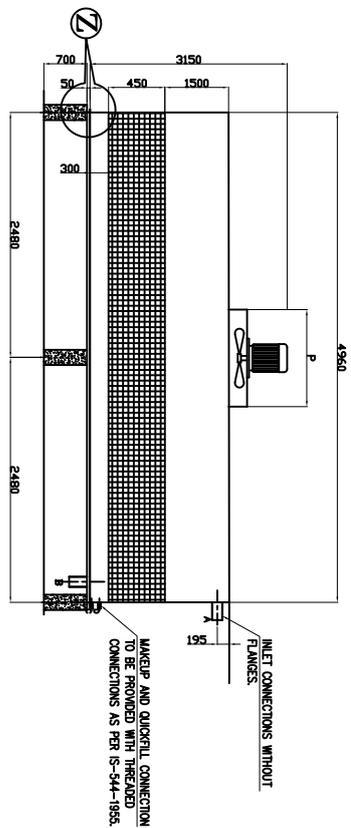


SIDE VIEW

MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREADED CONNECTIONS AS PER IS-544-1955.

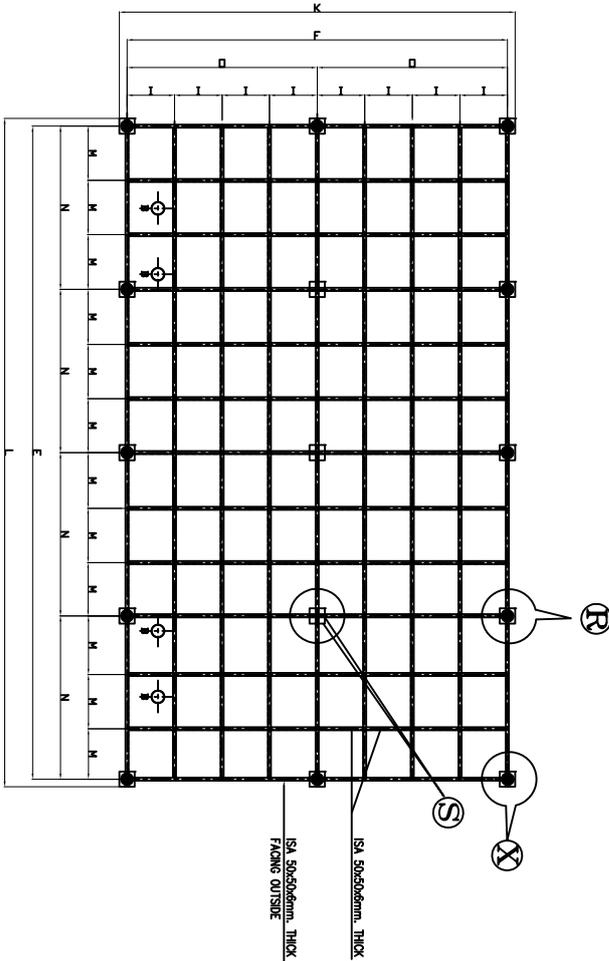


PLAN



DETAIL-X

ELEVATION OF PILLER WITHOUT BOLT OF MKD-"S" (QTY - 03 Nos.)

10 mm. HOLES AT THE DISTANCE OF 125mm. ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.



DETAIL-Z

ELEVATION OF PILLER WITH BOLT IN THE CENTER OF MKD-"R" (QTY - 12 Nos.)

ALL PERIPHERAL ISA (ANGLES) SHALL BE FACED OUTSIDE AND THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.

MARK	SIZES	QTY
K	150 x 4 NOS	2100
F	150 x 4 NOS	4960
O	50 EACH	2480
I	40 EACH	620
L	6168	6418
E	1542	6168
N	514	1542
M	514	1542
P	2100	514

DISCRIPTION	MARK	SIZES
INLET PIPE CONNECTION	A	150 x 4 NOS
OUT LET PIPE CONNECTION	B	150 x 4 NOS
DRAIN & OVERFLOW CONNECTION	C	50 EACH
MAKE UP AND QUICKFILL CONNECTION	D	40 EACH
LENGTH OF COOLING TOWER	E	6168
WIDTH OF COOLING TOWER	F	4960
FAN DIA AND NOS.	P	#2100 x 2 Nos.

- NOTES:-**
1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
 2. COOLING TOWER WILL BE ASSEMBLED ON ISA FRAME FIXED ON RCC FILLER THE FRAME IS UNDER PURCHASERS SCOPE.
 3. MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREADED CONNECTIONS AS PER IS-544-1955.
 4. INLET & OUTLET CONNECTION TO BE PROVIDED WITHOUT FLANGE.
 5. RCC BASIN AND RCC PILLERS 250x250x700 HEIGHT AND #12x 150 LONG BOLTS ARE UNDER PURCHASER SCOPE.
 6. #10 mm HOLE AT THE DISTANCE OF 5" ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.
 7. LOCATION OF OUTLET CONNECTION ACCORDING TO SITE REQUIREMENT.
 8. #12x150 LONG BOLTS SHALL BE GROUTED IN THE CENTRE OF OUTER COLUMNS AS SHOWN IN THE DRAWING.
 9. ALL ISA (ANGLES) ON PERIPHERAL WILL FACE OUTSIDE ie "T".

DELTA COOLING TOWERS P. LTD.

SITE:-

DRS: _____

CHKD: _____

APPD: _____

SCALE: NOT TO SCALE

JOB NO. _____

G.A. OF DRG. OF COOLING TOWER MODEL NO. 6600

SERIES - DFC 60

REV-0