
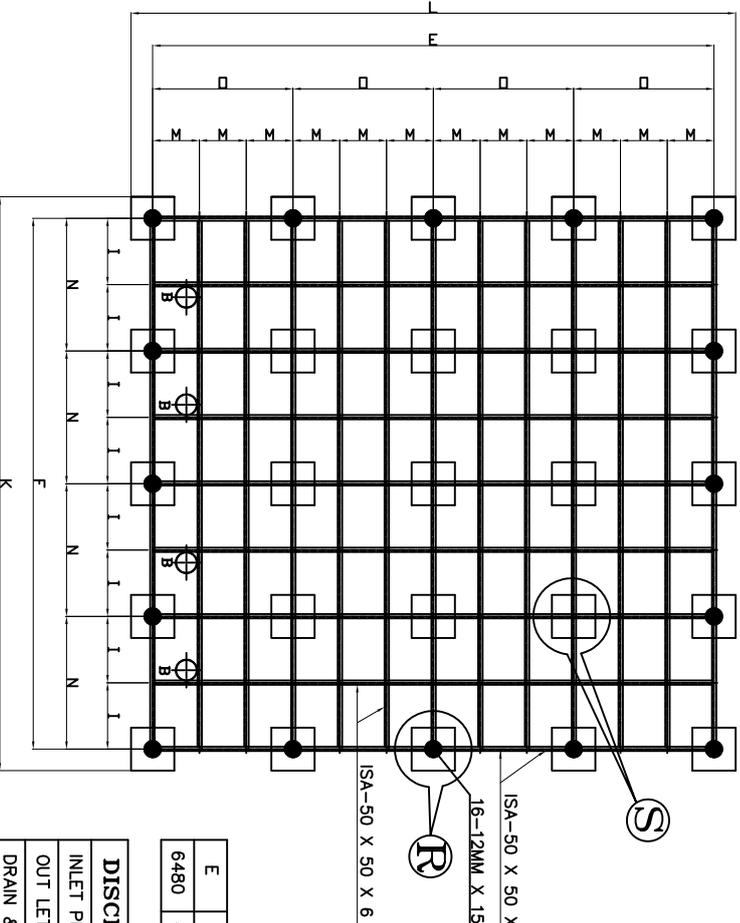



**ELEVATION OF PILLER WITHOUT BOLT OF MKD-"S"**  
(QTY-9Nos.)



**BASE FRAME**

E	F	K	L	I	M	O	N	P
6480	6176	6426	6730	772	540	1620	1544	2400

**ELEVATION OF PILLER WITH BOLT IN THE CENTER OF MKD-"R"**  
(QTY-16 Nos.)



DISCRPTION	MARK	SIZES
INLET PIPE CONNECTION	A	200 X 4 NOS
OUT LET PIPE CONNECTION	B	200 X 4 NOS.
DRAIN & OVERFLOW CONNECTION	C	50 EACH
MAKE UP AND QUICKFILL CONNECTION	D	40 EACH
LENGTH OF COOLING TOWER	E	6480
WIDTH OF COOLING TOWER	F	6176
FAN DIA AND NOS.	P	φ2400 X 2 Nos.

- NOTES:-**
1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
  2. COOLING TOWER WILL BE ASSEMBLED ON ISA FRAME FIXED ON RCC PILLAR THE FRAME IS UNDER PURCHASERS SCOPE.
  3. MAKEUP AND QUICKFILL CONNECTION TO BE PROVIDED WITH THREAD CONNECTIONS AS PER IS-544-1955.
  4. INLET & OUTLET CONNECTION TO BE PROVIDED WITHOUT FLANGE.
  5. RCC BASIN AND RCC PILLERS 250X250X700 HEIGHT AND φ12 X 150 LONG BOLTS ARE UNDER PURCHASER SCOPE.
  6. 10 MM HOLE AT THE DISTANCE OF 5" ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.
  7. LOCATION OF OUTLET CONNECTION ACCORDING TO SITE REQUIREMENT.
  8. φ12X150 LONG BOLTS SHALL BE GROUTED IN THE CENTRE OF OUTER COLUMNS AS SHOWN IN THE DRAWING.
  9. ALL ISA (ANGLES) ON PERIPHERAL WILL FACE OUTSIDE ie "T".

**DELTA COOLING TOWERS P. LTD.**

SITE:-

DES.	DRN	CHKD.	APPD.	SCALE NOT TO SCALE	JOB NO.	REV-0
	Adarsh					
<b>G.A OF DRG. OF COOLING TOWER MODEL NO. 6800</b>						
<b>SERIES- DFC 60</b>						