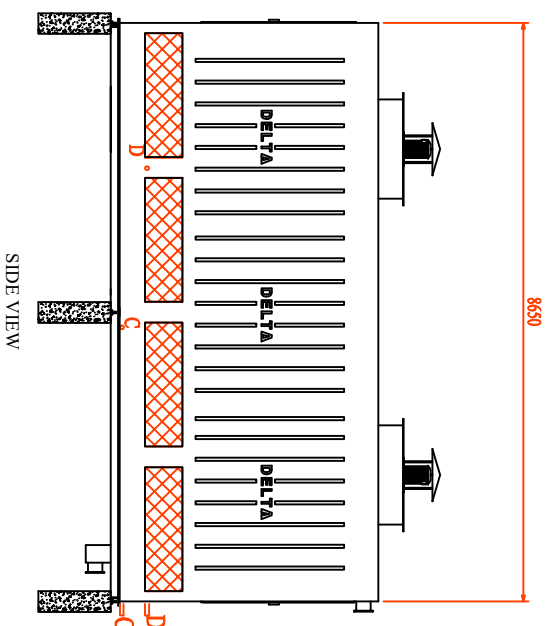
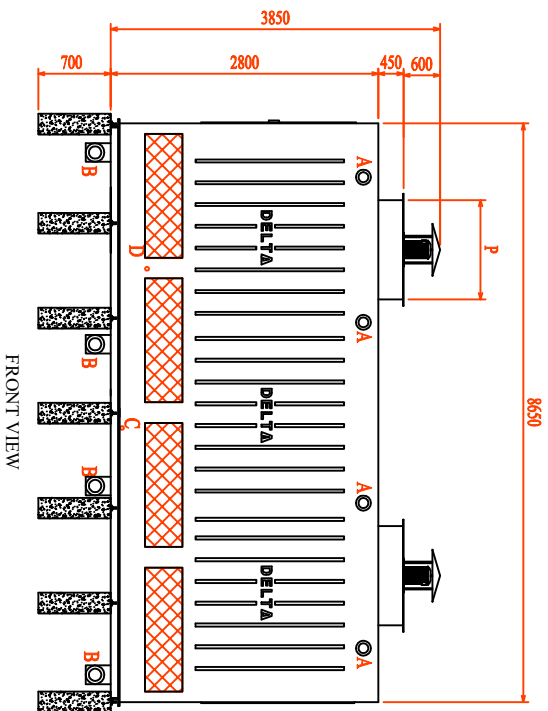


E	F	L	K	M	I	N	O	P	
8640	8640	8890	8890	540	540	2160	2160	24000	

DESCRIPTION	MARK	SIZES
INLET PIPE CONNECTION	A	250 X 4 NOS.
OUTLET PIPE CONNECTION	B	250 X 4 NOS.
DRAIN & OVERFLOW CONNECTION	C	65 X 2 NOS.
MAKEUP AND QUICKFILL CONNECTION	D	25 X 2 NOS.
LENGTH OF COOLING TOWER	E	8640
WIDTH OF COOLING TOWER	F	8640
FAN DIA AND NOS.	P	Ø 2400 X 4 Nos.

NOT TO SCALE / DO NOT SCALE DRAWING	REVISION
TITLE: FOUNDATION & BASE FRAME DRAWING OF COOLING TOWER MODEL No. 61K5 DPC-60	
COMPAR:	
Delta Cooling Towers P. Ltd Delhi	
(P.H. - 011-27495801/0020) EMAIL-DELTA@NDE/VSNL.NET.IN	
DWG NO.	DOCDEL08171001
DISSEMINATION/CONTACT	
SHEET 1 OF 1	

- NOTES:-**
1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
 2. COOLING-TOWER WILL BE ASSEMBLED ON ISA-50x50x6 FRAME FIXED ON RCC PILLAR THE FRAME IS UNDER PURCHASERS SCOPE.
 3. MAKEUP AND QUICKFILL CONNECTION SHALL BE PROVIDED WITH THREAD CONNECTIONS AS PER IS-544-1955.
 4. INLET & OUTLET CONNECTION SHALL BE PROVIDED WITHOUT FLANGE.
 5. RCC BASIN AND RCC PILLERS 250X250X700 Ht. AND Ø 12 X 150 LONG BOLTS/TORR ROD ARE UNDER PURCHASER SCOPE.
 6. 10MM HOLE AT THE DISTANCE OF 5" ON THE PERIPHERAL OF ISA OF THE BASE FRAME SHALL BE PROVIDED BY PURCHASER.
 7. LOCATION OF OUTLET CONNECTION SHALL BE ACCORDING TO SITE REQUIREMENT.
 8. Ø 12X150 LONG BOLTS/TORR ROD SHALL BE GROUDED IN THE CENTRE OF OUTER COLUMNS AS SHOWN IN THE DRAWING.
 9. ALL PICTURES SHOWN ARE FOR ILLUSTRATION PURPOSE ONLY AND MAY DIFFER FROM THE ACTUAL COOLING-TOWER MODEL.