



Front View

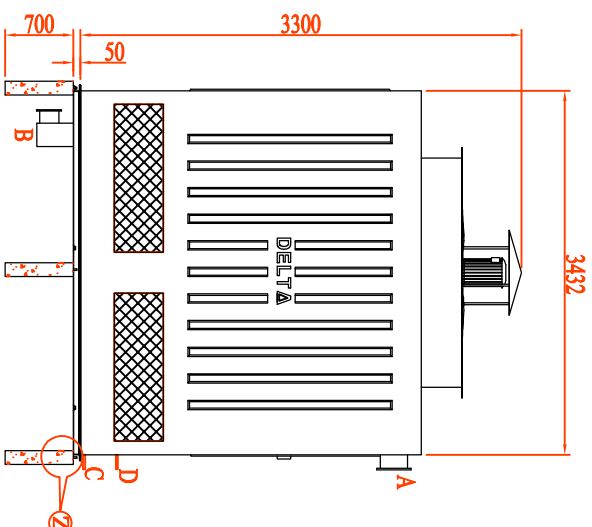

Side View

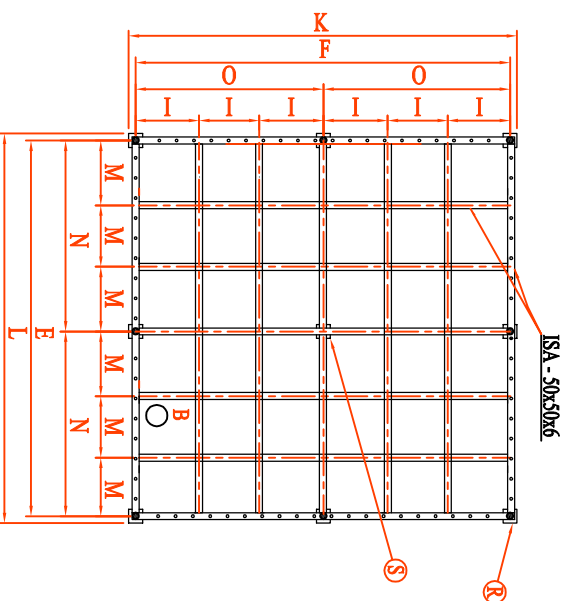



Base Frame

Notes:-

1. All dimensions are in millimeters.
2. Cooling tower will be assembled on iso-50x50x6 frame fixed on RCC pillar the frame is under purchasers scope unless otherwise stated.
3. Makeup and quickfill connection shall be provided with thread connections as per is-544-1955.
4. Inlet & outlet connection shall be provided without flange.
5. RCC basin and RCC pillars 250x250x700 ht. And  $\phi 12 \times 150$  long bolts/tor are under purchaser scope.
6. 10 mm hole at the distance of 125mm on the peripheral of ISA of the base frame shall be provided by purchaser.
7. Location of outlet connection will be as per the site requirement.
8.  $\phi 12 \times 150$  long bolts/tor shall be grouted in the centre of outer columns as shown in the drawing.
9. All pictures shown are for illustration purpose only and may differ from the actual cooling tower model.


E	F	K	L	M	I	N	O	P
3432	3432	3682	3682	572	572	1716	1716	1800

DESCRIPTION	MARK	SIZES
INLET PIPE CONNECTION	A	125 X 2 NOS.
OUTLET PIPE CONNECTION	B	150 X 1 NO.
DRAIN & OVERFLOW CONNECTION	C	50 EACH
MAKEUP AND QUICKFILL CONNECTION	D	25 EACH
LENGTH OF COOLING TOWER	E	3432
WIDTH OF COOLING TOWER	F	3432
FAN DIA AND NOS.	P	$\phi 1800 \times 1$ Nos.
OPERATING WEIGHT (KG.)		3600

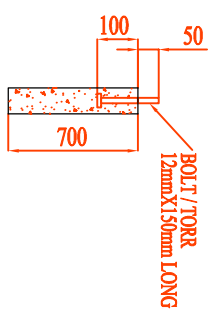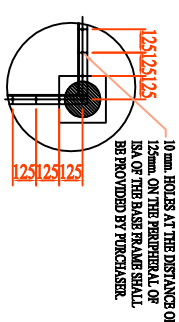


ELEVATION OF PILLER  
WITHOUT BOLT OF MKD - "R"  
(QTY - 8 NOS.)

ALL PERIPHERAL ISA (ANGLES) SHALL BE  
FACED OUTSIDE.



ELEVATION OF PILLER  
WITHOUT BOLT OF MKD - "S"  
(QTY - 1 NO.)



NOT TO SCALE / DO NOT SCALE DRAWING	JOB NO.:-
TITLE: G.A OF DRG. OF COOLING TOWER MODEL NO. 6225	
COMPANY: Delta Cooling Towers P. Ltd Delta (PH: 011-27493801/02/03) EMAIL: <a href="mailto:mail@delta.coil">mail@delta.coil</a>	
SITE:	
DesignOnConnect.com	REV :- 12/2017