



Front View

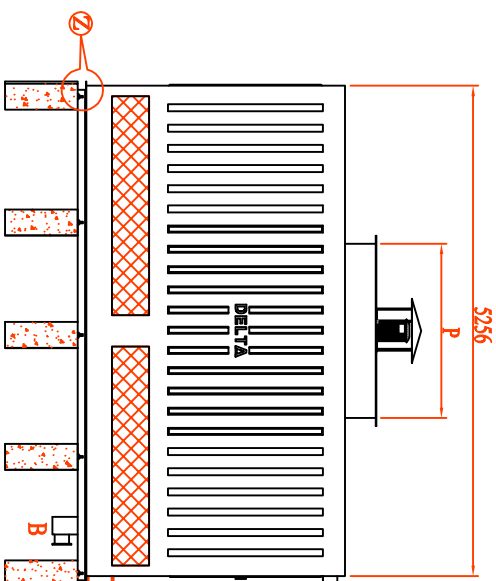


Side View

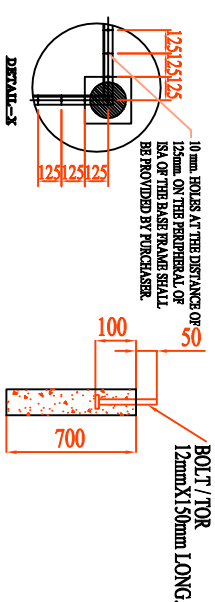

ELEVATION OF PILLER
WITHOUT BOLT OF MKD - "R"
(QTY- 16 NOS.)


ALL PERIPHERAL ISA (ANGLES) SHALL BE
FACED OUTSIDE.



ELEVATION OF PILLER
WITHOUT BOLT OF MKD - "S"
(QTY- 9 NOS.)

Notes:-

1. All dimensions are in millimeters.
2. Cooling tower will be assembled on ISA-50x50x6 frame fixed on RCC pillar the frame is under purchasers scope unless otherwise stated.
3. Makeup and quickfill connection shall be provided with thread connections as per is-544-1955.
4. Inlet & outlet connection shall be provided without flange.
5. RCC basin and RCC pillars 250x250x700 ht. And $\phi 12 \times 150$ long bolts/for are under purchaser scope.
6. 10 mm hole at the distance of 125mm on the peripheral of ISA of the base frame shall be provided by purchaser.
7. Location of outlet connection will be as per the site requirement.
8. $\phi 12 \times 150$ long bolts/for shall be grouted in the centre of outer columns as shown in the drawing.
9. All pictures shown are for illustration purpose only and may differ from the actual cooling tower model.

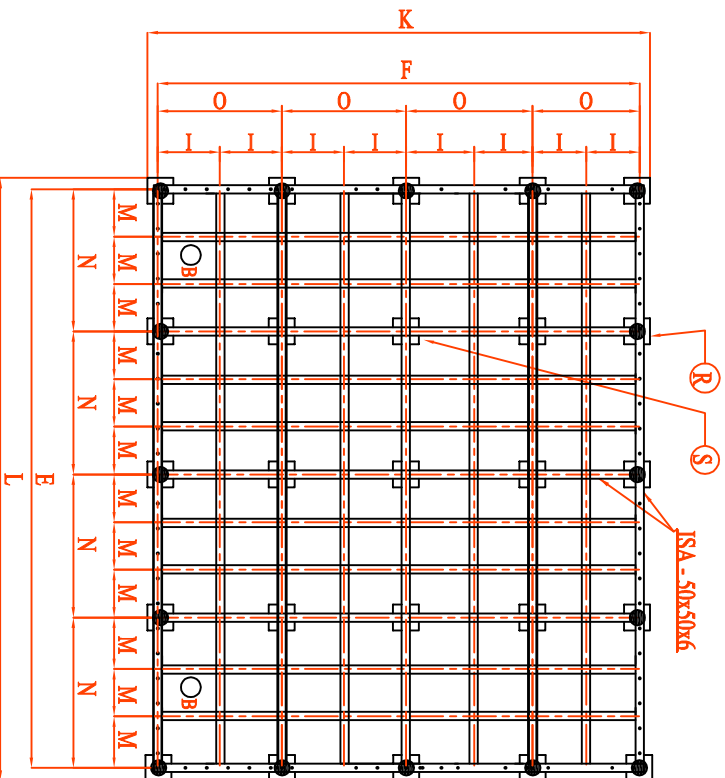

E	F	K	L	M	I	N	O	P
6180	5256	5506	6430	515	657	1545	1314	2400
DESCRIPTION		MARK		SIZES				
INLET PIPE CONNECTION		A		150 X 4 NOS.				
OUTLET PIPE CONNECTION		B		200 X 2 NOS.				
DRAIN & OVERFLOW CONNECTION		C		65 EACH				
MAKEUP AND QUICKFILL CONNECTION		D		40 EACH				
LENGTH OF COOLING TOWER		E		6180				
WIDTH OF COOLING TOWER		F		5256				
FAN DIA AND NOS.		P		$\phi 2400 \times 2$ Nos.				
OPERATING WEIGHT (KG.)				10000				

NOTE TO SCALE / DO NOT SCALE DRAWING		JOB NO.:-	
TITLE:			
G.A OF DRG. OF COOLING TOWER MODEL NO. 6650			
SERIES - DPC 60			
COMPANY:			
Delta Cooling Towers P. Ltd			
Delhi			
(PH - 011-27493801/02/03) EMAIL - info@delta.cool			
SITE:			
DesignOnConnect.com		REV :- 12/2017	