



Front View

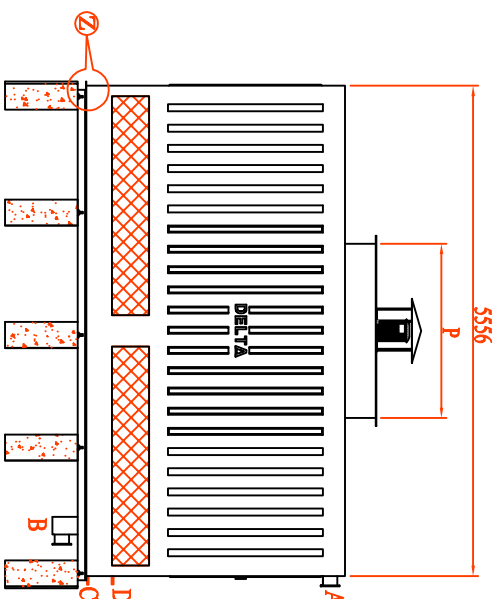


Side View

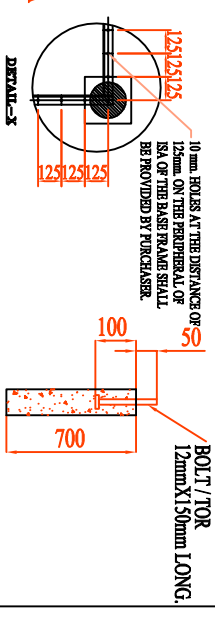

ELEVATION OF PILLER WITHOUT BOLT OF MKD - "R" (QTY- 16 NOS.)


ALL PERIPHERAL ISA (ANGLES) SHALL BE FACED OUTSIDE.



ELEVATION OF PILLER WITHOUT BOLT OF MKD - "S" (QTY- 9 NOS.)

Notes:-

1. All dimensions are in millimeters.
2. Cooling tower will be assembled on ISA-50x50x6 frame fixed on RCC pillar the frame is under purchasers scope unless otherwise stated.
3. Makeup and quickfill connection shall be provided with thread connections as per is-544-1955.
4. Inlet & outlet connection shall be provided without flange.
5. RCC basin and RCC pillars 250x250x700 ht. And  $\phi 12 \times 150$  long bolts/tor are under purchaser scope.
6. 10 mm hole at the distance of 125mm on the peripheral of ISA of the base frame shall be provided by purchaser.
7. Location of outlet connection will be as per the site requirement.
8.  $\phi 12 \times 150$  long bolts/tor shall be grouted in the centre of outer columns as shown in the drawing.
9. All pictures shown are for illustration purpose only and may differ from the actual cooling tower model.

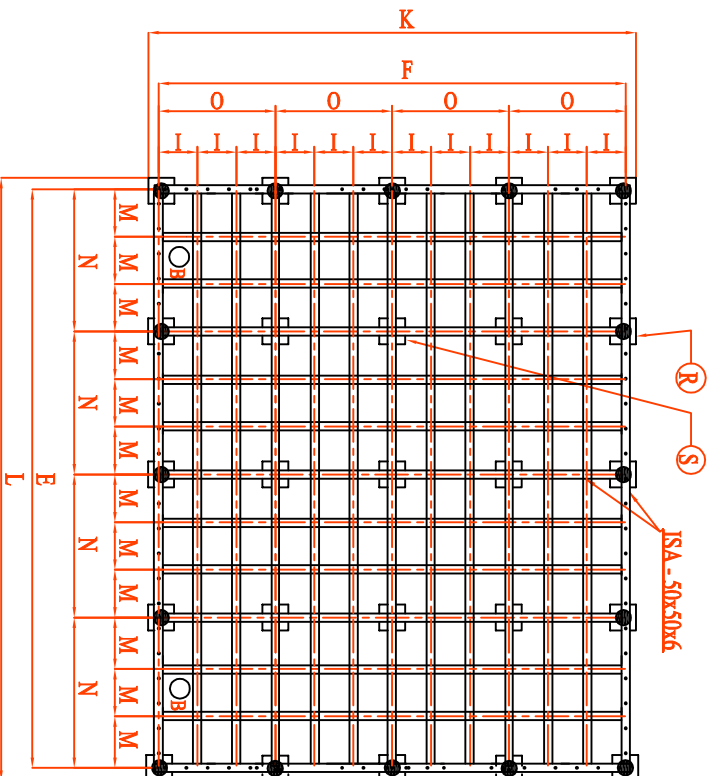

Base Frame

E	F	K	L	M	I	N	O	P
6180	5556	5810	6430	515	463	1545	1389	2400

DESCRIPTION	MARK	SIZES
INLET PIPE CONNECTION	A	150 X 4 NOS.
OUTLET PIPE CONNECTION	B	200 X 2 NOS.
DRAIN & OVERFLOW CONNECTION	C	65 EACH
MAKEUP AND QUICKFILL CONNECTION	D	40 EACH
LENGTH OF COOLING TOWER	E	6180
WIDTH OF COOLING TOWER	F	5556
FAN DIA AND NOS.	P	$\phi 2400 \times 2$ Nos.
OPERATING WEIGHT (KG.)		10700

NOTE TO SCALE / DO NOT SCALE DRAWING	DWG NO.-
TITLE: G.A OF DRG. OF COOLING TOWER MODEL NO. 6700 SERIES - DPC 60	
COMPANY: Delta Cooling Towers P. Ltd Delhi (PH - 011-2749380/02/03) EMAIL - mail@delta.cool	
SITE:	
Design@delta.cool	REV :- 12/2017