

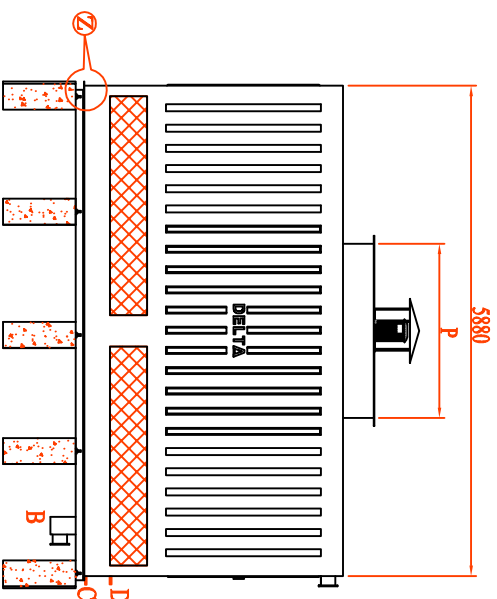




Front View



Side View

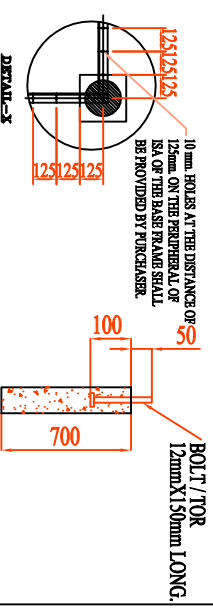


DESTINILS=77



**ELEVATION OF PILLER
WITHOUT BOLT OF MKD - "S"
(QTY-9 NO.)**

Notes:-

1. All dimensions are in millimeters.
2. Cooling tower will be assembled on isa-50x50x6 frame fixed on RCC pillar the frame is under purchasers scope unless otherwise stated.
3. Makeup and quickfill connection shall be provided with thread connections as per is-544-1955.
4. Inlet & outlet connection shall be provided without flange.
5. RCC basin and RCC pillars 250x250x700 ht. And $\phi 12 \times 150$ long bolts/tor are under purchaser scope.
6. 10 mm hole at the distance of 125mm on the peripheral of ISA of the base frame shall be provided by purchaser.
7. Location of outlet connection will be as per the site requirement.
8. $\phi 12 \times 150$ long bolts/tor shall be grouted in the centre of outer columns as shown in the drawing.
9. All pictures shown are for illustration purpose only and may differ from the actual cooling tower model.

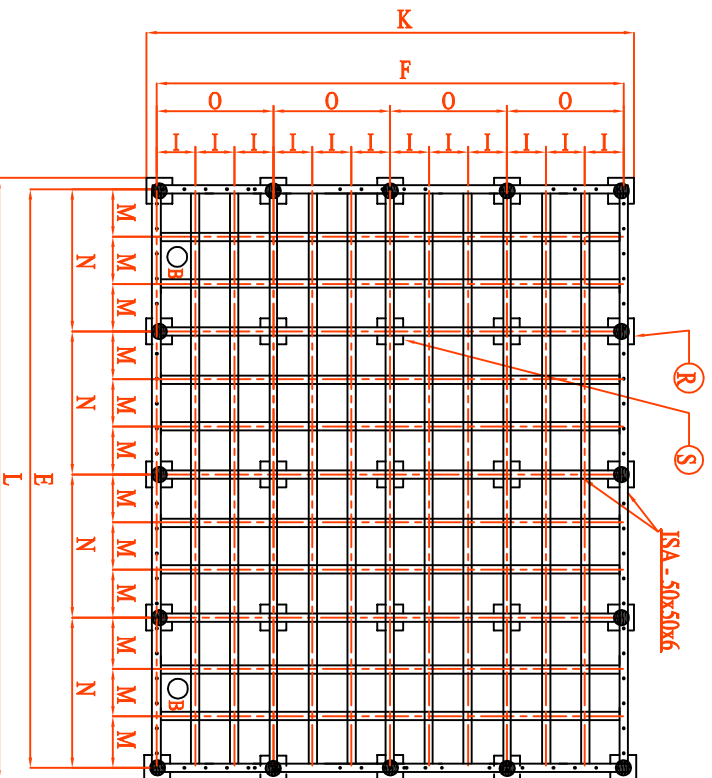

Base Frame

E	F	K	L	M	I	N	O	P
6180	5880	6122	6430	515	490	1545	1470	2400

DESCRIPTION	MARK	SIZES
INLET PIPE CONNECTION	A	150 X 4 NOS.
OUTLET PIPE CONNECTION	B	200 X 2 NOS.
DRAIN & OVERFLOW CONNECTION	C	65 EACH
MAKEUP AND QUICKFILL CONNECTION	D	40 EACH
LENGTH OF COOLING TOWER	E	6180
WIDTH OF COOLING TOWER	F	5880
FAN DIA AND NOS.	P	Ø2400 X 2 Nos.
OPERATING WEIGHT (KG.)		11300

INTO SCALE / DO NOT SCALE DRAWING		JOB NO.:-
TITLE G.A OF DRG. OF COOLING TOWER MODEL NO. 6750 SERIES - DFC 60		
COMPANY: Delta Cooling Towers P. Ltd Delhi (PH - 011-2749580/10203) EMAIL- mail@delta.coil		
DesignOnContact.com		REV - /2019