
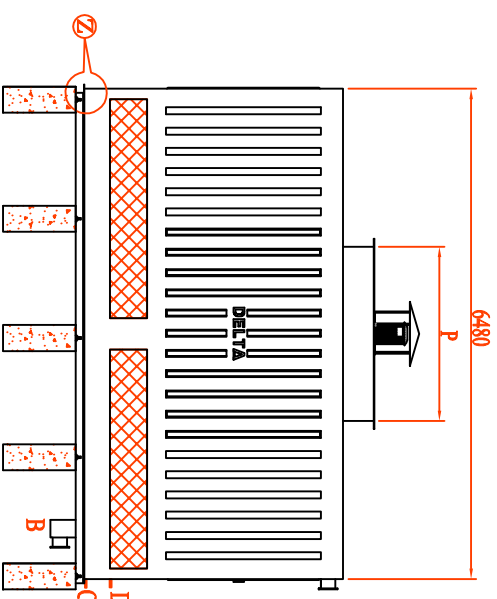


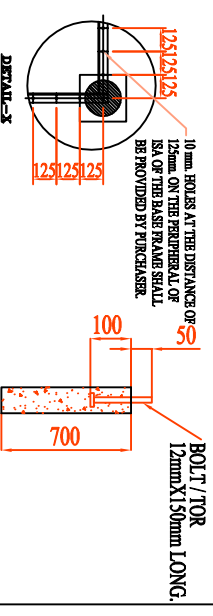


Front View




Side View

**DETAIL-2**

**ELEVATION OF PILE,
WITHOUT BOLT OF MKD - "S"
(QTY - 9 NO.)**

Notes:-

1. All dimensions are in millimeters.
2. Cooling tower will be assembled on ISA-50x50x6 frame fixed on RCC pillar the frame is under purchasers scope unless otherwise stlded.
3. Makeup and quickfill connection shall be provided with thread connections as per is-544-1955.
4. Inlet & outlet connection shall be provided without flange.
5. RCC basin and RCC piliers 250x250x700 ht. And $\phi 12 \times 150$ long bolts/tor are under purchaser scope.
6. 10 mm hole at the distance of 125mm on the peripheral of ISA of the base frame shall be provided by purchaser.
7. Location of outlet connection will be as per the site requirement.
8. $\phi 12 \times 150$ long bolts/tor shall be grouted in the centre of outer columns as shown in the drawing.
9. All pictures shown are for illustration purpose only and may differ from the actual cooling tower model.

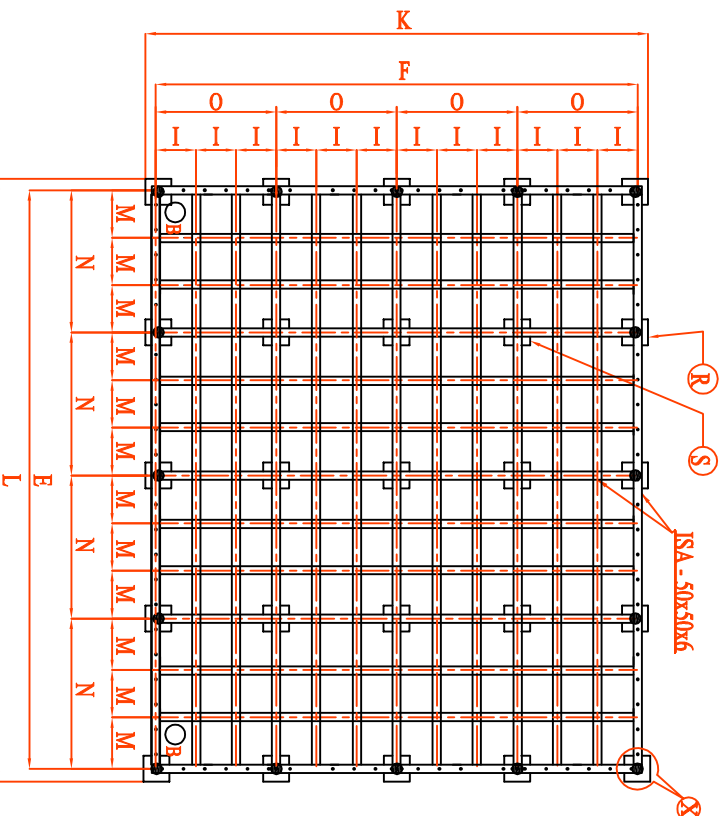

Base Frame

E	F	K	L	M	I	N	O	P
6780	6480	6730	7030	565	540	1695	1620	2700

DESCRIPTION	MARK	SIZES
INLET PIPE CONNECTION	A	150 X 4 NOS.
OUTLET PIPE CONNECTION	B	200 X 2 NOS.
DRAIN & OVERFLOW CONNECTION	C	65 X 1 NO.
MAKEUP AND QUICKFILL CONNECTION	D	40 X 1 NO.
LENGTH OF COOLING TOWER	E	6/80
WIDTH OF COOLING TOWER	F	6480
FAN DIA AND NOS.	P	Ø2700 X 2 Nos.
OPERATING WEIGHT (KG.)		13800

INTENT TO SCALE / DO NOT SCALE DRAWING		JOB NO.:-
TITLE G.A OF DRG. OF COOLING TOWER MODEL NO. 6900 SERIES - DFC 60		
COMPANET: Delta Cooling Towers P. Ltd Delhi		
(PH - 011-27495801/02/03) EMAIL- mail@delta.cool		
SITE:		
DesignOnContact.com		REV - 122017