

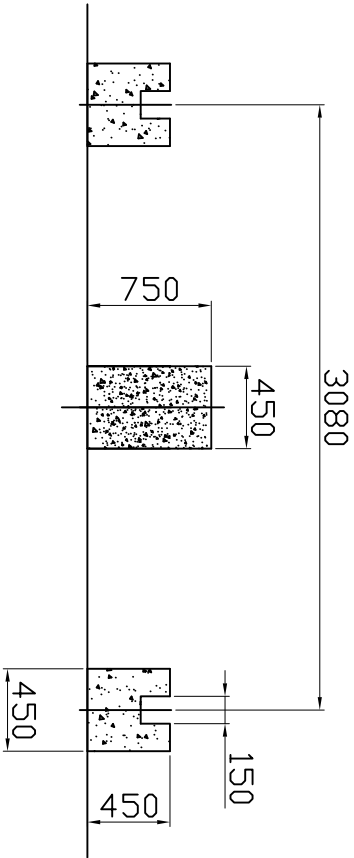
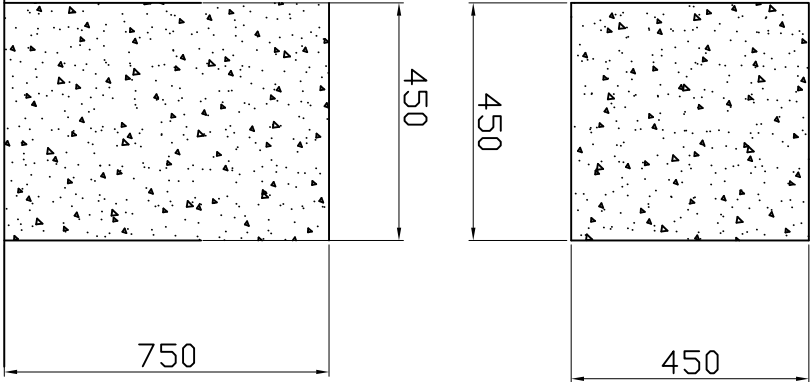


FOUNDATION PLAN

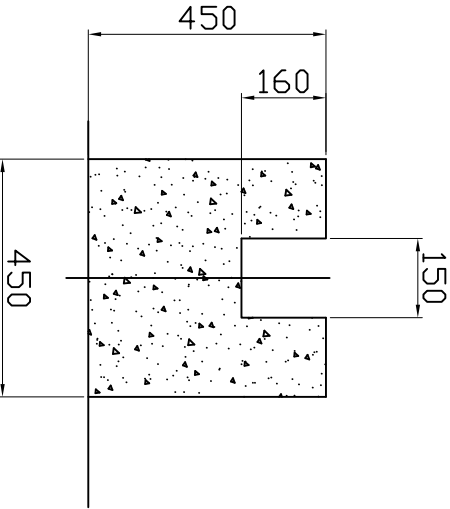

ELEVATION

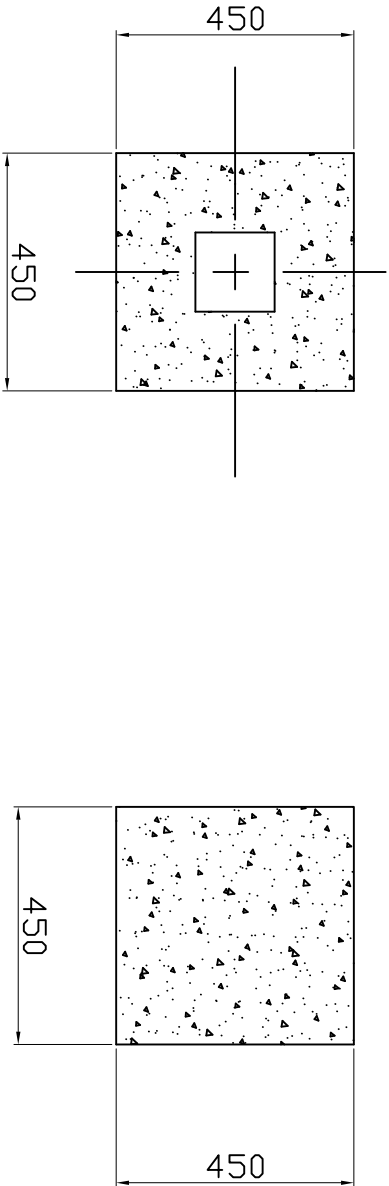

DET. OF MKD.-“X”

DET. OF MKD.-“Y”

NOTES:-

- 1. ALL DIMENSIONS ARE IN MM.
- 2. 4 BLOCK WILL BE MADE OF DIMENSION 450 X 450 X 450 HT. CENTRE BLOCK MADE OF DIMENSION 450 X450 X 750 HT.
- 3. FOUNDATION BOLTS SHALL BE PROVIDED BY PURCHASER. FDN BOLT SIZE 1/2” ϕ X 6” LONG. FOUNDATION PILLARS SHALL BE OF RCC/PCC/BRICK.
- 4. IN CASE OF MULTIPLE TOWERS, PLEASE MAINTAIN THE DISTANCE OF HALF OF THE COOLING TOWER DIAMETER. THE TOP LEVEL OF EACH SET OF FOUNDATION SHOULD BE ALIGNED AND MATCHED EVENLY.
- 5. TOP LEVEL OF ALL THE SIDE COLUMNS SHOULD BE MATCHED EQUALLY.
- 6. IN CASE OF MULTIPLE TOWERS, PLEASE MAINTAIN THE DISTANCE OF HALF OF THE COOLING TOWER DIAMETER. THE TOP LEVEL OF EACH SET OF FOUNDATION SHOULD BE ALIGNED AND MATCHED EVENLY.

SITE:- DELTA COOLING TOWERS P. LTD.

DES.		TITLE
DRN.	25-6-15	FOUNDATION DRG. OF COOLING TOWER MODEL NO. 5071 / 5072 SERIES- DFC 50
CHKD.		
APPD.		
SCALE NOT TO SCALE		

JOB NO.			REV-0
L	M	N	